GHBH Series

GHBH 003 34 1R7

Technical datasheet

Goorui Blower
Since 1933 Germany

Goorui blower performance curves

Vacuum selection diagram curve

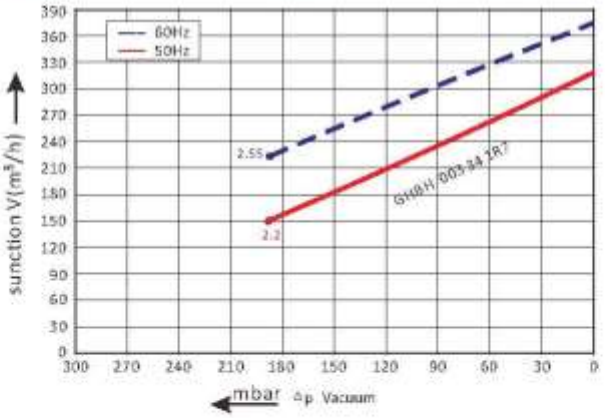

Compressor selection diagram curve

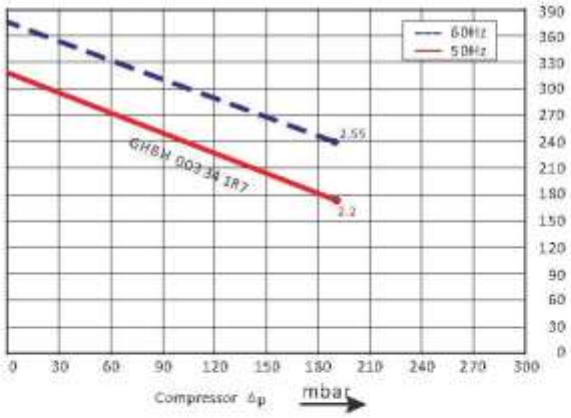

Goorui blower installation drawing

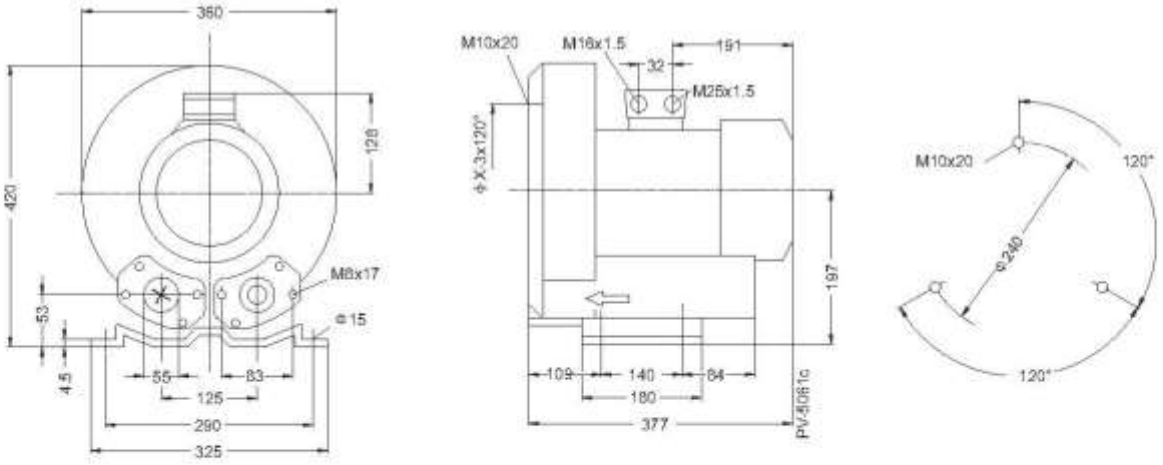

Goorui blower parameter

Model	Frequency	Output	voltage	Current	airflow	pressure		noise	Weight
	Hz	KW	V	A	m³/h	vacuum mbar	compressor mbar	dB(A)	kg
3" 50/60Hz IP54 INSULATION class F									
GHBH 003 34 1R7	50	2.2	200-240Δ/345-415Y	9.7Δ/5.6Y	318	-190	190	69	29
GHBH 003 34 1R7	60	2.55	220-275Δ/380-480Y	10Δ/5.8Y	376	-190	190	72	29

The performance curves of Goorui blower is tested through below ways:
Under one atmospheric pressure, suck15℃ air and then you can calculate the data,of course allow 10% difference,and when the sucked air and surroundings temperature are not higher than 25℃,you still can get total pressure difference as the curves shows.